

LBS

Contact: Joshua Mollison - DM 4959

Email: josh@LBSconsult.com.au

LBSconsult.com.au

Phone: 0422 649 295

LBS REFERENCE NUMBER: LBS29501

DATE: Monday, 28 October 2024

PROJECT ADDRESS: 212 Churchill Rd, Prospect SA 5082

PRINCIPAL'S PROJECT REQUIREMENTS - ESD

PINDER APARTMENTS ON CHURCHILL

BUILDING CLASS: Class 2

REPORT COMMISSIONED BY: Daniel Brunoli

ON BEHALF OF: Heather and Barrie Pinder

CLIENT REFERENCE NUMBER: TBC

CONTENTS

PRINCIPAL'S PROJECT REQUIREMENTS - ESD	1
CONTENTS	ii
DOCUMENT CONTROL	ii
1.0 INTRODUCTION	1
ENVIRONMENTALLY SUSTAINABLE DESIGN (ESD) ASSESSMENT TOOLS	1
ESD STRATEGY	2
SITE DESCRIPTION	2
2.0 SUSTAINABLE INITIATIVES	4
CONSTRUCTION AND BUILDING MANAGEMENT	4
INTEGRATED WATER MANAGEMENT	6
OPERATIONAL ENERGY	8
INDOOR ENVIRONMENT QUALITY	10
TRANSPORT	11
WASTE & RESOURCE RECOVERY	12
URBAN ECOLOGY	13
3.0 CONCLUSION	14
DISCLAIMER	14
APPENDIX A – VOC LIMITS	15
APPENDIX B – DAYLIGHT REPORT	18
COMPLIANCE SUMMARY	18
CALCULATION METHODOLOGY	18
MODELLING OUTPUT	19
SIMULATION SUMMARY	22
CONCLUSION	22

DOCUMENT CONTROL

Revision	Date	Description	Author	Reviewed
v1.0	25 th Oct 2024	For Review	NM	JM

1.0 INTRODUCTION

The project team is committed to creating an environmentally sustainable and liveable project by incorporating environmentally sustainable design into the development.

As requested by ODASA, this Principal's Project Requirements (ESD) has been prepared to establish how the proposed development will incorporate sustainability and address the below objectives, outlining the relevant stakeholder/s and project stage/s for each initiative to assist the project team during the design, construction, and operation process.

The following key elements of sustainability have been identified:

Construction & Building Management

Transport

Integrated Water Management

Waste & Resource Recovery

Operational Energy

Urban Ecology

Indoor Environment Quality

ENVIRONMENTALLY SUSTAINABLE DESIGN (ESD) ASSESSMENT TOOLS

The following sustainability benchmarks have been used to assess the proposed development against the objectives outlined above.

- Sustainable Design in the Planning Process (SDAPP)
- Built Environment Sustainability Scorecard (BESS)
- Green Star Buildings v1.0
- Green Star Design & As Built v1.3
- NCC Vol1 2019 Amd.1
- Australian Standards
- ASHRAE
- Walk Score

ESD STRATEGY

The project team has collaborated to consider ESD principles and initiatives during the design phase, these principles have been based on the following ESD hierarchy:

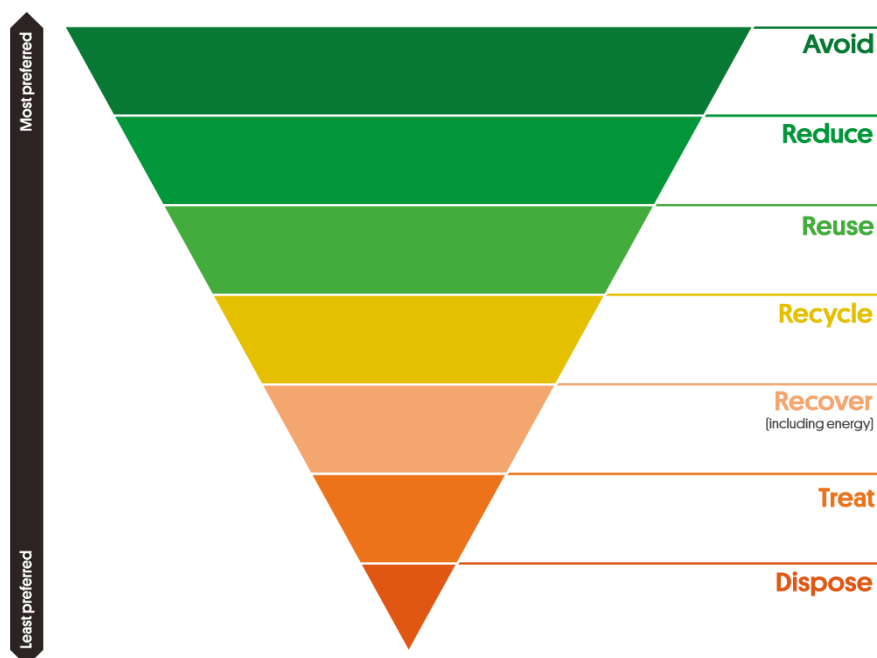


Figure 1 - ESD Hierarchy (Source: Green Industries SA¹)

SITE DESCRIPTION

Proposed Building Works	Mixed-Use Tower
Total Building Area	1,804m ²
Ground Floor (619m²)	Carpark, lobby, stairs & lift, bin room, services, retail tenancy (not considered in this report).
Floors 1-3 (395m²)	Apartments (ex. balconies), corridor, stairs & lift.
Rooftop	Terrace
Total Site	710.7m ²

¹ Supporting the Circular Economy: South Australia's Waste Strategy 2020-2025 (2020), Green Industries SA

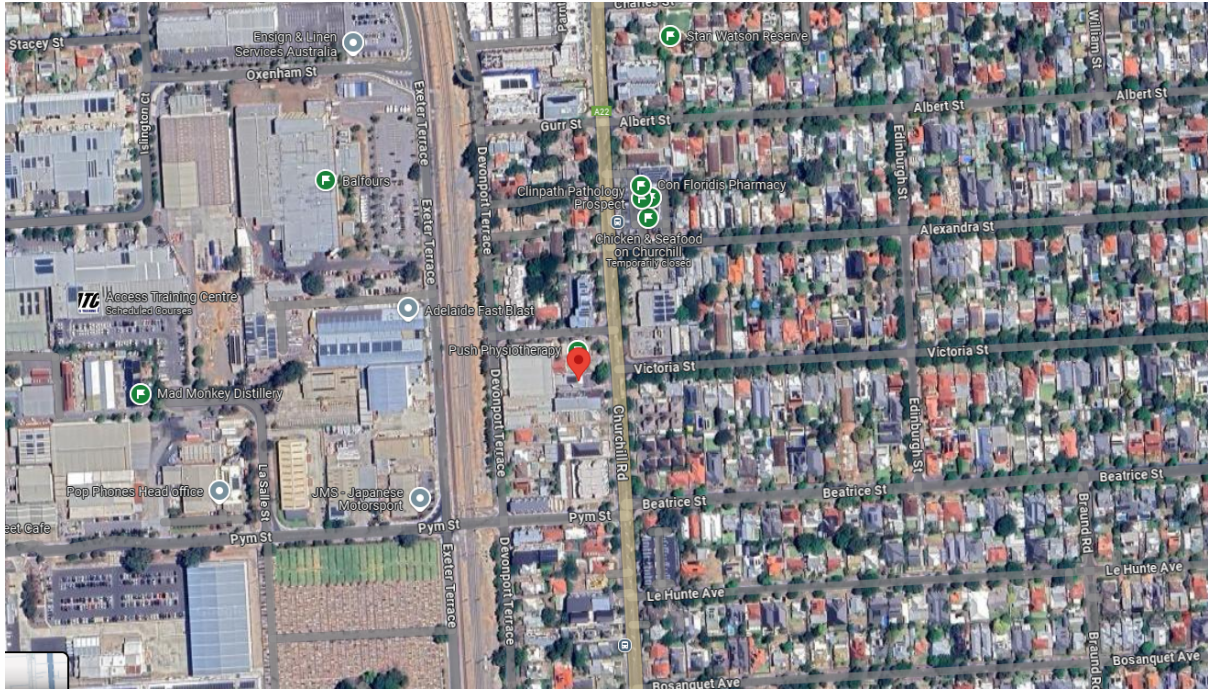


Figure 2 – Proposed Location



Figure 3 - Proposed Development

2.0 SUSTAINABLE INITIATIVES

The following sections outline the sustainable initiatives that will be incorporated into the design, construction, and operation of the proposed development. In addition, this section outlines the relevant project stage and nominates the appropriate project stakeholder responsibility. **All responsibilities of the Architect are to be documented on the plans prior to council submission.**

CONSTRUCTION AND BUILDING MANAGEMENT

Objective: To encourage a holistic and integrated design and construction process and ongoing high performance.

- ✓ Integrate sustainable principles into the development from concept through to construction and operation.
- ✓ Ensure the environmental impact of construction is managed.
- ✓ Future proof the proposed development for future occupants.
- ✓ Make key building services and sustainability information accessible for occupants.

DESIGN INITIATIVE	STAKEHOLDER	PROJECT STAGE
ESD Professional	ESD	Concept-Design
<i>Green Star Buildings v1.0 – 1 Industry Development – Green Star Accredited Professional (Credit Achievement)</i>		
An ESD professional is to be engaged to provide sustainability advice during design stage.		
Construction Environmental Management Plan	Head Contractor	Construction Documentation
<i>Green Star Buildings v1.0 Credit 2 Responsible Construction – EMS, EMP</i>		

The builder or head contractor (responsible party) must have a formalised systematic and methodical approach to planning, implementing, and auditing in place during construction.

- [If contract <\$10 million] The responsible party must have an Environmental Management System (EMS) that complies with either the NSW Environmental Management System Guidelines or another recognised framework.
- [If contract >\$10 million] The responsible party must have an Environmental Management System (EMS) certified to a recognised standard such as AS/NZS ISO 14001, BS 7750 or the European Community's EMAS.

The EMS can be stand-alone or part of an integrated management system and must be valid for the duration of construction activities.

The Head Contractor is to implement a project-specific Environmental Management Plan (EMP) to manage the environmental performance and impact of excavation and construction activities.

Construction Stormwater Management	<i>Development Manager</i>	<i>Construction Documentation</i>
<i>SDAPP Construction and Building Management Best Practice Standards</i>		
<p>The project team recognises that the construction of the proposed development creates potential environmental impacts associated with stormwater runoff, including erosion and sediment. A Site Management Plan will be developed in accordance with local authority and EPA Construction Techniques for Sediment and Pollution Control. Risks managed during construction may include but are not limited to:</p> <ul style="list-style-type: none"> ▪ General erosion and site runoff ▪ Redirection or temporary storage of existing roof runoff ▪ Erosion and pollutants from vehicle access and work areas ▪ Erosion and deposition from stockpiles ▪ Waste and litter management 		
Metering	ESD	Design Development
<i>BESS Management 3.1 Metering - Residential / 3.3 Metering - Common Areas</i>		
<ul style="list-style-type: none"> ▪ Utility meters (electricity, water & gas if applicable) will be provided for all individual dwellings. ▪ Utility sub-meters will be provided to all major common area services. ▪ Separate metering is to be provided for all energy and water uses. In addition: <ul style="list-style-type: none"> ▪ Where an energy load exceeds 5% of total energy uses or 100kW is must be independently metered. ▪ Where a common water use consumes at least 10% of the projects water use it must be independently metered. 		
Building Users Guide	<i>Development Manager</i>	<i>Construction Documentation</i>
<i>BESS Management 4.1 Building Users Guide</i>		
<p>A Buildings User Guide and building information is to be developed and made available to the building owner, facilities management team, and occupants at the time of practical completion. This is to outline the following for all nominated building systems:</p> <ul style="list-style-type: none"> ▪ Operations and maintenance information ▪ Building logbook ▪ Building user information: <ul style="list-style-type: none"> ▪ Description of energy efficiency initiatives ▪ Description of water efficiency initiatives ▪ Description of basic function of nominated building systems ▪ Strategies to optimise the building's performance and efficiency, including operational strategies to reduce energy and waste use, and waste production. ▪ List of maintenance contacts 		
On-going Management	<i>Development Manager, Services Contractors</i>	<i>Post Occupancy</i>
<i>Green Star Buildings v1.0 Credit 3 Verification and Handover</i>		
<p>The building manager is responsible for the implementation, monitoring, maintenance, and review of all initiatives outlined in this report.</p> <p>This report and all supporting ESD reports are to be included in all document packs for the building manager and tenants.</p>		

INTEGRATED WATER MANAGEMENT

Objective: To ensure the efficient use of water, to reduce total operating potable water use, to encourage the appropriate use of alternative water sources, and to incorporate the use of water sensitive urban design, including rainwater re-use.

- ✓ Use efficient fixtures and fittings.
- ✓ Capture and re-use rainwater.
- ✓ Connect to recycled water infrastructure.
- ✓ Include indigenous/water efficient landscaping and irrigation methods.
- ✓ Minimise the use of mains water for toilets, urinals, and landscape irrigation by maximising on-site rainwater reuse.
- ✓ Reduce the impact and volume of stormwater runoff.

DESIGN INITIATIVE	STAKEHOLDER	PROJECT STAGE
Rainwater Collection & Reuse	Civil Engineer, Development Manager	Design Development
<i>BESS Integrated Water Management 1.1 Potable Water Use; 2.1 Stormwater Treatment</i>		

Best Practice Stormwater Management is to be implemented with the following rainwater reuse and stormwater management initiatives:

- Rainwater catchment area connected to $\geq 6,000\text{L}$ rainwater retention tank.
- Rainwater tank with mains backup to be connected to Laundromat for reuse.

Stormwater Quality & Treatment	Civil Engineer, Development Manager	Design Development
<i>BESS Integrated Water Management 2.1 Stormwater Treatment</i>		

Best practice stormwater management is to be demonstrated by modelling showing the following pollutant reduction targets are achieved:

Element	Required Reduction*
Flow (ML/Year)	≥ 0
Total Suspended Solids (kg/year)	80%
Total Phosphorous (kg/year)	45%
Total Nitrogen (kg/year)	45%
Gross Pollutants (kg/year)	70%

*Urban Stormwater – Best Practice Environmental Management Guidelines (Victorian Stormwater Committee, 1999)

Water Fixtures	Architect	Design Development
<i>BESS Integrated Water Management 1.1 Potable Water Use – Fixtures, Fittings, and Connections; Green Star Buildings v1.0 25 Water Use (Min. Expectation)</i>		

The development will include efficient fitting and fixtures to reduce the consumption of mains water. The following Water Efficiency Labelling Scheme (WELS) star rating products are required (within 1 star of best available):

- Taps: ≥ 5 Star WELS
- WCs: ≥ 4 Star WELS
- Showerheads: ≥ 4 Star WELS ($\leq 7.5\text{L/m}$)
- Dishwashers: ≥ 5 Star WELS

Water Efficient Landscaping	Architect	Design Development
<i>BESS Integrated Water Management 3.1 Water Efficient Landscaping</i>		
<ul style="list-style-type: none"> ▪ Water efficient/drought tolerant plants to be planted in all landscaped areas. ▪ If irrigation is required during plant establishment, drip or under mulch irrigation is to be used. 		
Building System Water Use Reduction	Development Manager	Construction Documentation
<i>BESS Integrated Water Management 4.1 Building Systems Water Use Reduction</i>		
HVAC system to use air cooled condenser components.		

OPERATIONAL ENERGY

Objective: To ensure the efficient use of energy, to reduce total operating greenhouse emissions, and to reduce energy peak demand.

- ✓ Ensure energy efficiency is incorporated into planning and design.
- ✓ Include effective shading.
- ✓ Enhance building fabric above minimum building code requirements.
- ✓ Install efficient appliances, lighting, and heating and cooling systems.
- ✓ Promote the use of alternative energy sources.
- ✓ Achieve or work towards net zero carbon emissions.

DESIGN INITIATIVE	STAKEHOLDER	PROJECT STAGE
Preliminary Energy Modelling	ESD	Design Development

NCC 2019, Vol. 1; Green Star Buildings v1.0 – 22 Energy Use – Reference Building Pathway (Credit Achievement)

Preliminary modelling has been completed on a sample of apartments which are representative of the project's apartment typologies.

The Green Star Buildings Energy Use credit was used as a benchmark for modelling, requiring a weighted-area average of NatHERS 7 Stars and minimum 6 Stars for each sole-occupancy unit. This improves on the NCC 2019 requirement of a weighted-area average of 6 Stars and minimum of 5 Stars.

Preliminary Section J energy modelling outlines the proposed design represents a 21% improvement against NCC compliance. The following minimum specification is to be incorporated into the design:

- ≥R1.3 roof blanket with reflective foil to Level 3 framed roofs
- ≥R4.0 insulation to Level 3 ceilings below external slab or framed roofs
- ≥R2.5 insulation to all external framed walls
- ≥R3.0 (2 x R1.5) insulation to all internal party walls
- ≥R1.5 insulation to all internal wet areas
- ≥R2.0 insulation to slab over unconditioned Ground floor spaces with Apartments above
- ≥200mm concrete slab floors to all levels
- Dowell double glazing (or equivalent) to all windows and doors. Total system values:
 - Sliding door - U-value: ≤3.8 SHGC: 0.55±5% VLT: 0.59
 - Awning window - U-value: ≤3.41 SHGC: 0.52±5% VLT: 0.53±5%
 - Fixed window - U-value: ≤2.92 SHGC: 0.62±5% VLT: 0.64±5%
- ≥10kW Solar PV system (roof mounted) with ≥8kW inverter

Lift and External Lighting	Electrical	Design Development
----------------------------	------------	--------------------

SDAPP Energy Best Practice Standards; NCC Volume 1

Green Star Buildings v1.0 – 35 Impacts to Nature – Managing Light Pollution Impacts (Min. Expectation)

- Lift and external lighting to be high efficiency LED lighting with occupancy sensors and daylight control (external lighting only) fitted in accordance with NCC 2019 Vol1. Amd 1.
- Light Pollution to neighbouring bodies: All outdoor lighting on the project complies with AS/NZS 4282:2019 Control of the obtrusive effects of outdoor lighting to minimise the building's light pollution.
- Light pollution to night sky: The project will reduce light pollution by either:
 - Control of upward light output ratio (ULOR); OR
 - Control of direct illuminance.

Internal Lighting

Services Engineer

Design Development

BESS Operational Energy 3.6 Internal Lighting – Apartments; SDAPP Energy Best Practice Standards

- All indoor lighting to be LED warm white colour.
- Maximum illumination power density in at least 90% of the Class 2 area is $\geq 20\%$ lower than NCC requirements (Table J6.2a NCC 2019 Vol.1).

INDOOR ENVIRONMENT QUALITY

Objective: To achieve a healthy indoor environment quality for the wellbeing of building occupants.

- ✓ Consider air quality, natural ventilation, and daylight access.
- ✓ Control shading, glare, and noise.
- ✓ Maintain thermal comfort.

DESIGN INITIATIVE	STAKEHOLDER	PROJECT STAGE
Daylight Access	ESD	Design Development
<i>Green Star Design & As Built v1.3 – 12 Visual Comfort - 12.1 Daylight</i>		
The proposed design provides good levels of natural light to occupied areas, achieving a daylight factor of at least 1.5% to 69.5% of the designated floor areas. Refer to Appendix B Daylight Report.		
Ventilation Systems – Fresh Air	Services Engineer	Construction Documentation
<i>Green Star Buildings v1.0 – 10 Clean Air – Provision of Outdoor Air (Min. Expectation)</i>		
The regularly occupied areas must be provided with good access to outdoor air, appropriate for the activities and conditions by using one of the following options: <ul style="list-style-type: none"> ▪ Where ventilation is by mechanical means, the building must provide outdoor air as per AS1668.2:2012 for the default occupancy. ▪ Where ventilation is by natural means, the building must meet natural ventilation requirements as per AS1668.4:2012. 		
Ventilation System Attributes	Mechanical	Design Development Construction
<i>Green Star Buildings v1.0 – 10 Clean Air – Ventilation System Attributes</i>		
<u>Separation from Pollutants:</u> Building ventilation systems to be designed to comply with ASHRAE Standard 62.1:2013 or AS 1668:2012 (whichever is greater) regarding minimum separation distances between pollution sources and outdoor air intakes.		
<u>Cleaning Ductwork:</u> All new and existing ductwork that serves the building must be either sealed until installation/project completion or cleaned prior to occupation in accordance with a recognised standard.		
<u>Maintenance:</u> Mechanical ventilation systems will be designed/located to provide adequate access for maintenance to both sides of moisture/debris catching components within the air distribution system.		
Exposure to Toxins	Architect, Development Manager	Construction Documentation
<i>Green Star Buildings v1.0 – 13 Exposure to Toxins (Min. Expectation)</i>		
>95% of all new paints, adhesives, sealants (by volume), and carpets (by area), and engineered wood products (by area) meet the total VOC or formaldehyde limits specified by Green Star (see Appendix A) or hold a relevant certification (e.g. GECA, Global GreenTag, GreenRate).		
Thermal Comfort	Architect	Design Development
<i>BESS IEQ 3.1 Thermal comfort – Double Glazing, 3.2 Thermal Comfort – External Shading</i>		
The following measures are to be included to assist in maintaining thermal comfort: <ul style="list-style-type: none"> ▪ All glazing is to be double glazing. ▪ Shade hoods or awnings are to be incorporated to all north, east, and west facing external glazing to habitable rooms to reduce solar heat gain and assist in maintaining thermal comfort. 		

TRANSPORT

Objective: To minimise car dependency and to ensure that the built environment is designed to promote the use of low-emission transport options such as public transport, walking, and cycling.

- ✓ Provide convenient and secure bike storage.
- ✓ Encourage use of lower emission transport options.

DESIGN INITIATIVE	STAKEHOLDER	PROJECT STAGE
Bicycle Parking Facilities	Architect, Development Manager	Design Development
<i>Green Star Buildings v1.0 – 27 Movement and Place – Bicycle Parking Facilities (Credit Achievement)</i>		

The building’s access must prioritise walking and cycling options – well lit, weather protected, and separated from vehicles.

Bicycle parking facilities must meet the following criteria:

- Separated from the primary vehicle entrance to ensure safety.
- Ensure the cycling equipment is safely secured.
- The access points must connect to the relevant bicycle storage facilities.

The development includes 6 bicycle parking spaces.

Reducing Private Vehicle Usage	Transport Planner, ESD	Design Development
<i>Green Star Buildings v1.0 – 27 Movement and Place – Reducing Private Vehicle Usage (Credit Achievement)</i>		

The building’s design and location reduce emissions associated with transport with excellent access to public transport via train and bus. A bike path also runs along Churchill Rd, facilitating active transport.

Walk Score provides the following scores for the project location:

212 Churchill Road

Prospect, Adelaide, 5082

Commute to **Downtown Adelaide**

9 min
 20 min
 21 min
 60+ min
 [View Routes](#)

Favorite

Map

Nearby Apartments

Walk Score

65

Somewhat Walkable


Some errands can be accomplished on foot.

Transit Score

52

Good Transit

Many nearby public transportation options.

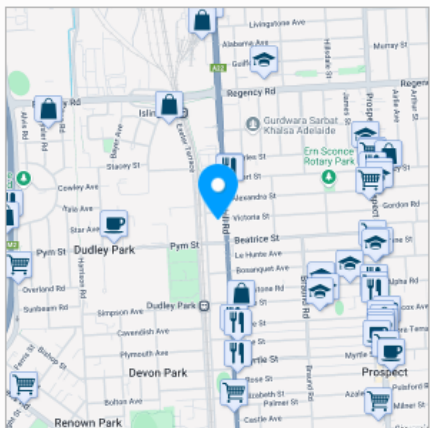

[About your score](#)

[Add scores to your site](#)

WASTE & RESOURCE RECOVERY

Objective: To ensure waste avoidance reuse and recycling during the construction and operation stages of development.

- ✓ Promote waste avoidance, re-use, and recycling during the planning, design, construction, and operation of the proposed development.
- ✓ Consider food and garden waste opportunities.
- ✓ Put construction waste and operational waste management plans in place.

DESIGN INITIATIVE	STAKEHOLDER	PROJECT STAGE
Construction Waste	Development Manager	Construction
<i>Green Star Buildings v1.0 – 2 Responsible Construction – Construction and Demolition Waste (Min. Expectation)</i>		
≥80% of demolition and construction waste (by mass) will be recycled or re-used. The builder will develop a construction waste management plan for the demolition, pre-construction, civil works, and construction phases.		
Operational Waste	Architect, Development Manager	Design Development
<i>BESS Waste 2.1 - Operational Waste - Food & Garden Waste; 2.2 - Operational Waste - Convenience of Recycling Green Star Buildings v1.0 – 2 Responsible Resource Management (Min. Expectation)</i>		
The building must provide bins or storage containers to building occupants to enable them to separate their waste, in accordance with the following:		
<ul style="list-style-type: none"> ▪ Bins must be labelled, with all waste streams equally convenient to access. ▪ Waste Streams are to include general waste, co-mingled recycling, and organic waste. ▪ A dedicated and appropriately sized area(s) for the storage and collection of the waste streams must be provided. 		
Bins must be sized and collected in accordance with third-party best practice guidelines such as City of Adelaide Council guidelines.		

URBAN ECOLOGY

Objective: To protect and enhance biodiversity and to encourage the planting of indigenous vegetation.

- ✓ Consider green spaces that focus on health, social, environmental, and economic benefits.
- ✓ Encourage and consider the retention of existing significant trees.
- ✓ Maintain and/or enhance the site's ecological value.
- ✓ Consider climate change and minimise use of potable water.

DESIGN INITIATIVE	STAKEHOLDER	PROJECT STAGE
Communal Spaces	Architect	Design Development
<i>BESS Urban Ecology 1.1 Communal Spaces; 2.4 Balconies, Courtyards, and Roof Terraces</i>		
The proposed development provides a 200m ² roof terrace where people can gather for social exchange. The roof terrace includes drought-tolerant landscaping, seating, and outdoor cooking facilities.		
Encouraging Green Spaces	Architect	Design Development
<i>BESS Urban Ecology 2.4 Balconies, Courtyards, and Roof Terraces</i>		
All balconies, courtyards, and roof terraces are to have water supply (a tap) and a wastewater connection (drain) to promote and facilitate vegetation on balconies.		

3.0 CONCLUSION

This PPR sets a standard of sustainability for the project using the following recognised benchmarks:

- Sustainable Design in the Planning Process (SDAPP)
- Built Environment Sustainability Scorecard (BESS)
- Green Star Buildings v1.0
- Green Star Design & As Built v1.3
- NCC Vol1 2019 Amd.1
- Australian Standards
- ASHRAE
- Walk Score

The proposed development will meet and/or exceed the objectives if it is constructed in accordance with the contents of the report, supporting documentation, and applicable drawings. This report is to be read in conjunction with any relevant reports written by third parties. It is the responsibility of the Principal Consultant to ensure the implementation, monitoring, maintenance, and review of all initiatives outlined in this report are upheld.

DISCLAIMER

LIVING BUILDING SOLUTIONS has prepared this document for the sole use of the Client and for a specific purpose, each as expressly stated in the document. No other party should rely on this document without the prior written consent of LIVING BUILDING SOLUTIONS. LIVING BUILDING SOLUTIONS undertakes no duty, nor accepts any responsibility, to any third party who may rely upon or use this document. This document has been prepared based on the Client's description of its requirements and LIVING BUILDING SOLUTIONS experience, having regard to assumptions that LIVING BUILDING SOLUTIONS can reasonably be expected to make in accordance with sound professional principles. LIVING BUILDING SOLUTIONS may also have relied upon information provided by the Client and other third parties to prepare this document, some of which may not have been verified. Subject to the above conditions, this document may be transmitted, reproduced or disseminated only in its entirety.

APPENDIX A – VOC LIMITS

Compliance with Low VOC products is met the product meets the requirements of Table 3 or is recognised under a Product Certification Scheme - <http://new.gbca.org.au/product-certification-schemes/>

Table 1 - Max TVOC Limits for Paints, Adhesive and Sealants

Product Category	Max TVOC content in grams per litre of ready to use product
General purpose adhesives and sealants	50
Interior wall and ceiling paint, all sheen levels	16
Interior wall and ceiling paint, all sheen levels	75
Primers, sealers and prep coats	65
One and two pack performance coatings for floors	140
Acoustic sealants, architectural sealant, waterproofing membranes and sealant, fire retardant sealants and adhesives	250
Structural glazing adhesive, wood flooring and laminate adhesives and sealants	100

Compliance with Carpets is met by demonstrating the carpet meets the requirements of Table 4 or is recognised under a Product Certification Scheme - <http://new.gbca.org.au/product-certification-schemes/>

Table 2 - Carpet Test Standards and TVOC Emissions Limit

Compliance Option	Test Protocol	Limit
ASTM D5116	ASTM D5116 - Total VOC limit*	0.5mg/m ² per hour
	ASTM D5116 - 4-PC (4-Phenylcyclohexene)*	0.05mg/m ² per hour
ISO 16000 / EN 13419	ISO 16000 / EN 13419 - TVOC at three days	0.5 mg/m ² per hour
ISO 10580 / ISO/TC 219 (Document N238)	ISO 10580 / ISO/TC 219 (Document N238) - TVOC at 24 hours	0.5 mg/m ² per hour

* Both limits should be met when testing against ASTM D5116

Compliance with engineered wood products is met by demonstrating the product meets the requirements of Table 5 or is recognised under a Product Certification Scheme - <http://new.gbca.org.au/product-certification-schemes/>

Table 3 - Formaldehyde Emission Limit Values for Engineered Wood Products

Test Protocol	Emission Limit / Unit of Measure
S/NZS 2269:2004, testing procedure AS/NZS 2098.11:2005 method 10 for Plywood	≤1mg/ L
AS/NZS 1859.1:2004 - Particle Board, with use of testing procedure AS/NZS 4266.16:2004 method 16	≤1.5 mg/L
AS/NZS 1859.2:2004 - MDF, with use of testing procedure AS/NZS 4266.16:2004 method 16	≤1mg/ L
AS/NZS 4357.4 - Laminated Veneer Lumber (LVL)	≤1mg/ L
Japanese Agricultural Standard MAFF Notification No.701 Appendix Clause 3 (11) - LVL	≤1mg/ L
JIS A 5908:2003- Particle Board and Plywood, with use of testing procedure JIS A 1460	≤1mg/ L
JIS A 5905:2003 - MDF, with use of testing procedure JIS A 1460	≤1mg/ L
JIS A1901 (not applicable to Plywood, applicable to high pressure laminates and compact laminates)	≤0.1 mg/m ² hr*
ASTM D5116 (applicable to high pressure laminates and compact laminates)	ASTM D5116 (applicable to high pressure laminates and compact laminates)
ISO 16000 part 9, 10 and 11 (also known as EN 13419), applicable to high pressure laminates and compact laminates	≤0.1 mg/m ² hr (at 3 days)
ASTM D6007	≤0.12mg/m ³ **
ASTM E1333	≤0.12mg/m ³ ***
EN 717-1 (also known as DIN EN 717-1)	≤0.12mg/m ³
EN 717-2 (also known as DIN EN 717-2)	≤3.5mg/m ² hr

*mg/m²hr may also be represented as mg/m²/hr.

**The test report must confirm that the conditions of Table 3 comply for the particular wood product type, the final results must be presented in EN 717-1 equivalent (as presented in the table) using the correlation ratio of 0.98.

***The final results must be presented in EN 717-1 equivalent (as presented in the table), using the correlation ratio of 0.98.

APPENDIX B – DAYLIGHT REPORT

COMPLIANCE SUMMARY

Level 2 of the proposed development has been assessed using the prescribed *Daylight Modelling Methodology* outlined in the *Green Star - Design & As Built v1.3 Submission Guidelines* to demonstrate compliance with the following compliance pathway:

- 12.1B Compliance Using Daylight Factor

Compliance with *12.1B Compliance Using a Daylight Factor* is achieved where it is demonstrated that $\geq 40\%$ of the nominated area achieves a daylight factor of at least 1.5%, assuming a uniform sky of 10,000 lux. Points are awarded as follows:

- For $\geq 40\%$ of the nominated area – 1 point; or
- For $\geq 60\%$ of the nominated area – 2 points.

69.5% of nominated areas of the proposed development achieve the minimum 1.5% daylight factor and a total of 2 points are awarded.

CALCULATION METHODOLOGY

The assessment has been undertaken in accordance with the Green Star Design and As Built *Submission Guidelines* criteria with the ‘nominated’ areas defined as all **primary space** within the development:

Primary space – All areas where a person is expected to work, or remain for an extended period of time, including, but not limited to:

- Offices, either open plan or private;
- Residential lounge rooms and bedrooms;
- Classrooms, laboratories, computer labs;
- Ward rooms, nurse’s stations, clinic rooms;
- Kitchen and preparation areas where food is being sold;
- Retail / sales floor, exhibition halls, galleries (unless exclusion is justified), multi-purpose rooms (as a general setting); and
- Occupied areas within industrial buildings such as manufacturing spaces, shop floors and work stations. Warehouse and distribution spaces are considered primary space only if the majority of the space is an area where people expected work or remain for an extend period of time.

The nominated areas considered in this assessment are articulated on the floor plan/colour gradient images in the Modelling Output section and Simulation Summary results tables.

Note: the floor area values may not correlate with figures noted on the drawings due to differences in definitions of space and calculation methodology.

The results were calculated using the DesignBuilder Radiance simulation engine which provides a detailed multi-zone physics-based calculation of illumination levels on the working planes of the building. The calculations allow light to be transmitted through exterior and interior windows and the shading and reflective effect of local shading devices and component/assembly blocks is included.


The modelling is based on the attached architectural drawings and the following assumptions:

- All horizontal shading elements are fixed/non-operable (e.g. terraces)
- External glazing has a visible light transmittance (VLT) values as shown below:
 - Awning Window (DOW-005-02) = 0.53
 - Fixed Window (DOW-015-02) = 0.64
 - Sliding Door (DOW-007-03) = 0.59
- Internal/External floor surface reflectance of 30%
- Internal wall surface reflectance of 70%
- Internal ceiling surface reflectance of 80%
- Working plane nominated as finished floor level
- No significant overshadowing elements
- Uniform design sky of 10,000 lux (ISO 15469:2004)
- Modelling grid area of 0.1m x 0.1m
- Perimeter margin of 0.1m
- Adelaide Airport (IWEC2) location/weather file

Daylight Factor is defined as the ratio of internal horizontal illuminance to external global horizontal illuminance. It represents the proportion of available external light which illuminates a given point inside the building.

MODELLING OUTPUT

LEVEL 2:

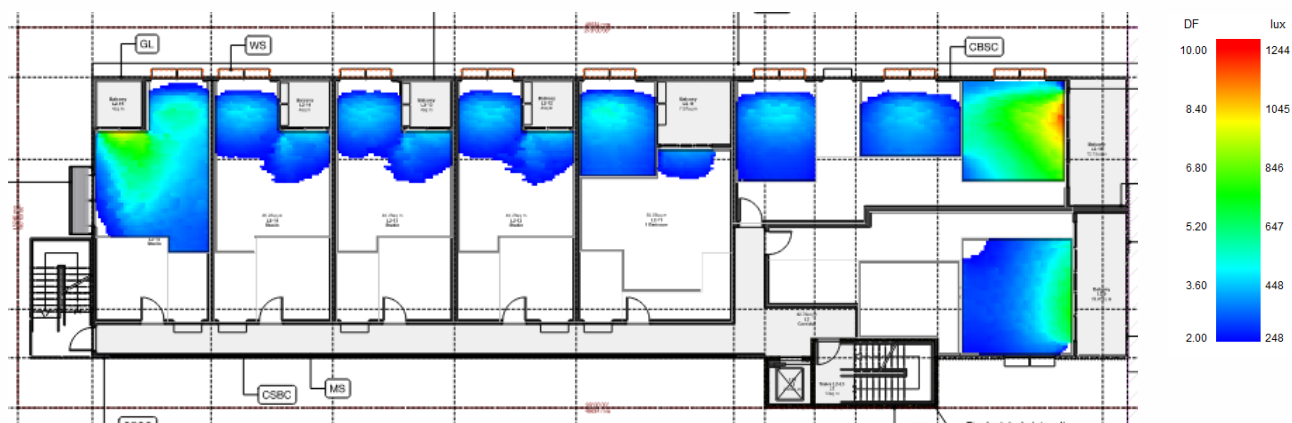


TYPICAL END STUDIO:



TYPICAL STUDIO:




TYPICAL 1 BEDROOM:

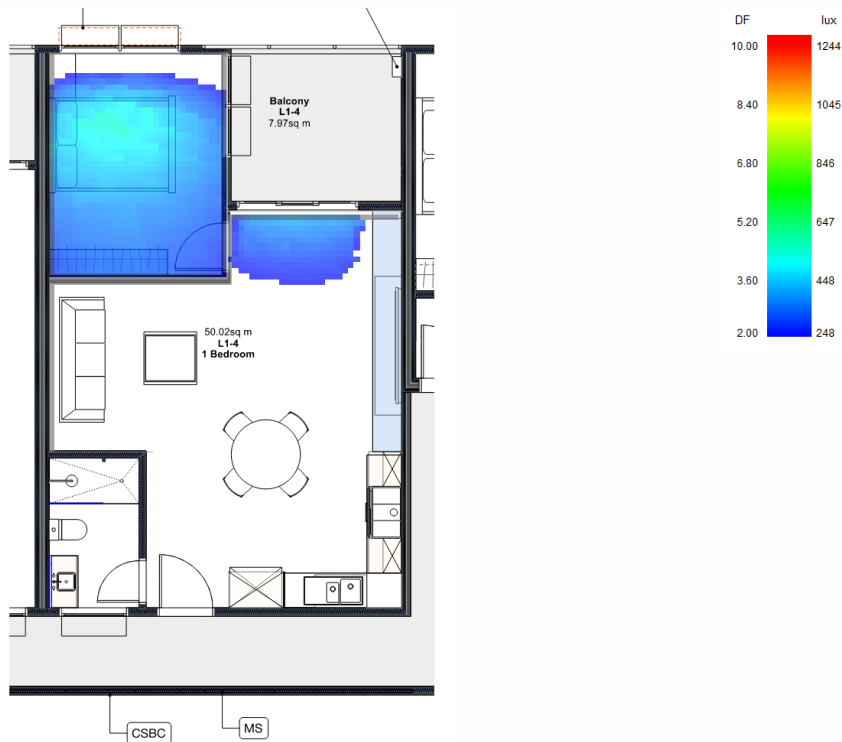

TYPICAL 1 BEDROOM:



TYPICAL 2 BEDROOM:

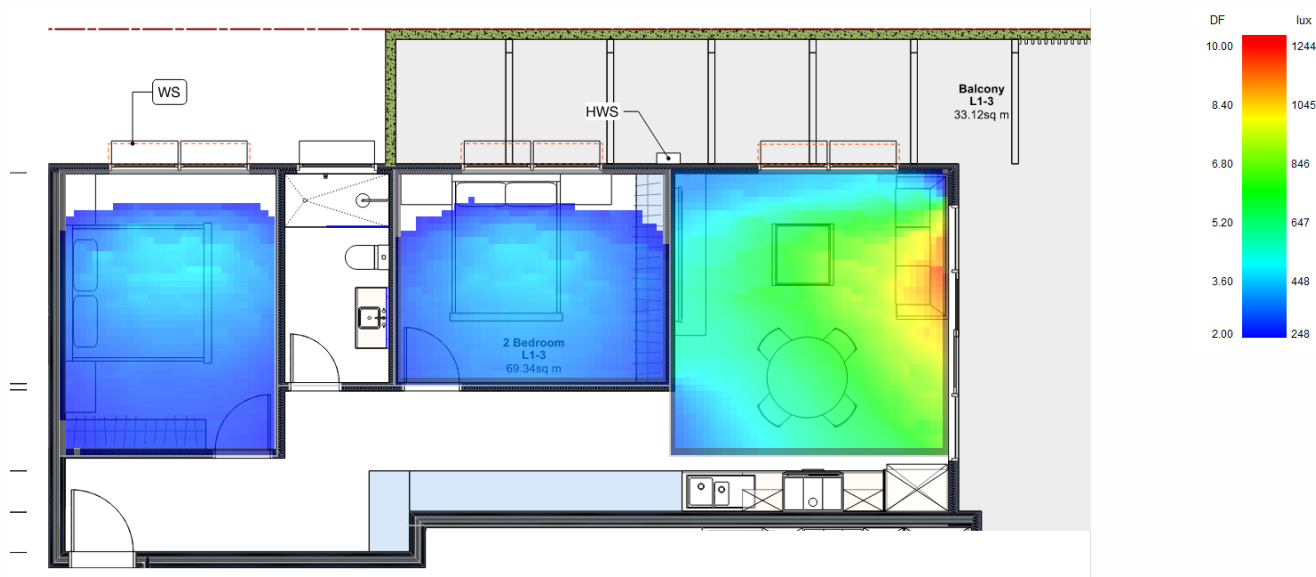

SIMULATION SUMMARY

The proposed development has been assessed and 69.5% of the nominated residential areas achieve the minimum 1.5% daylight factor.

LEVEL	AREA TYPE	FLOOR AREA (m ²)	FLOOR AREA ABOVE 2.0% DF (m ²)	FLOOR AREA ABOVE 2.0% DF (%)
Level 2	L2-9 Bed	13.6	0.0	0.0
Level 2	L2-9 Living	21.2	21.1	99.7
Level 2	L2-10 Bed 1	13.5	12.9	95.6
Level 2	L2-10 Bed 2	12.9	11.6	89.6
Level 2	L2-10 Living	17.4	17.4	100.0
Level 2	L2-11 Bed	12.2	12.1	98.8
Level 2	L2-11 Living	27.2	3.9	14.4
Level 2	L2-12 Living	26.9	16.7	62.0
Level 2	L2-13 Living	26.9	16.9	63.0
Level 2	L2-14 Living	26.8	17.2	64.3
Level 2	L2-15 Living	26.7	26.7	100.0
Total		225.3	156.5	69.5

DF = Daylight Factor

CONCLUSION

Detailed energy modelling and daylight analysis has been undertaken on Level 2 of the proposed residential development at 212 Churchill Road, Prospect, SA 5082. The results of the analysis demonstrate the nominated areas of the proposed development meet the requirements of 12.1B Compliance Using Daylight Factor with 2 points being awarded for credit 12.1 Daylight.